


COVER PER SUBMITTAL

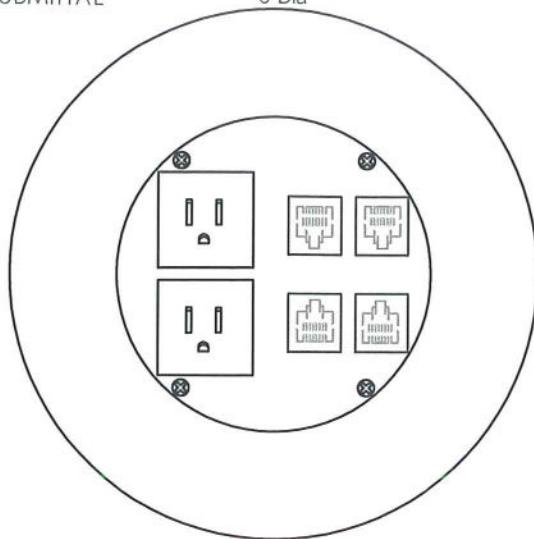

TOP VIEW


MOI-SLB-PWR2-COMM4

2 openings for single receptacle and 4 openings for COMM jacks (openings suitable for all manufacturers Keystone style jacks) COMM jacks not supplied or installed by Nocom Inc.


NOTE:

Single receptacles shall be 5-15RA.
5-20RA available


CROSS SECTION

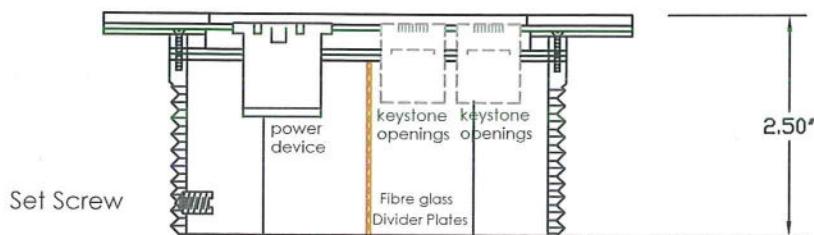

DEVICE MOUNTING BRACKET
C/W THREAD HUB AS SHOWN

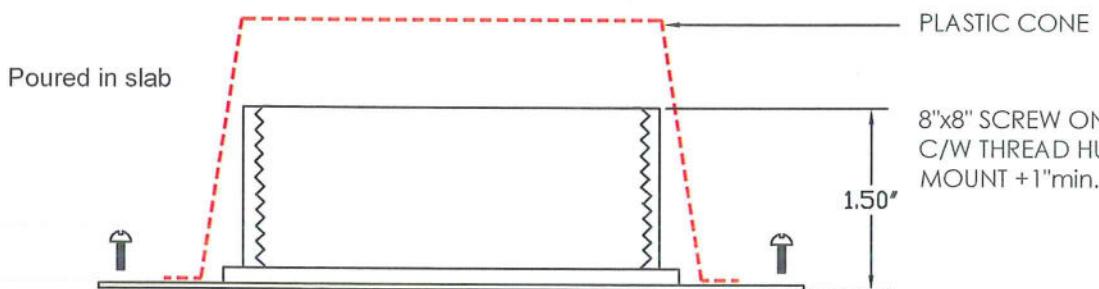

8"x8" SCREW ON COVER (4 CORNERS)
C/W THREAD HUB AS SHOWN
MOUNT +1"min. to 2" max.BELOW NEW TILE

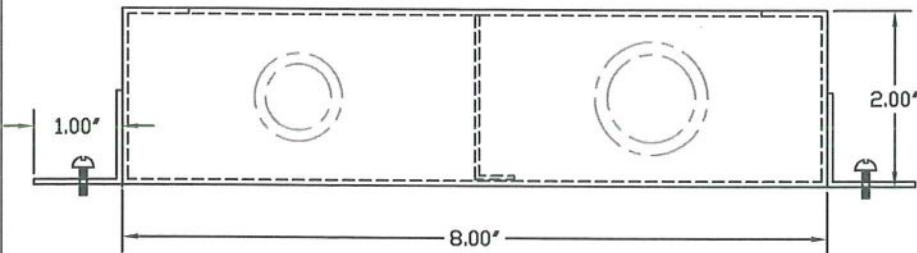

8"x8"x2" STANDARD BOX
WITH CENTRE BARRIER
C/W 2x[1/2-3/4"] k.o's
2x[3/4"-1"] k.o's

NOTE:

Keystone style openings, blanks or CSA/UL Recognized/ Classified or Listed comm jacks

ORDERING INFO-(SEE ABBREVIATIONS)

SLAB THICKNESS _____

RECEPT.TYPE/colour _____

DATA MANUF./colour _____

COVER TYPE _____

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF NOCOM. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF NOCOM IS PROHIBITED.

		DIMENSIONS ARE IN MM TOLERANCES: ANGLES: \pm DEGREE LINEAR: \pm MM (UNLESS SPECIFIED)		NAME		DATE (yy-mm-dd)	JOB TITLE:
		MATERIAL See Variant table		DRAWN	TJP	10-03-03	
		FINISH		CHECKED			
NEXT ASST	USED ON	APPLICATION	DO NOT SCALE DRAWING	ENG. APPR.			COMMENTS:
				MFG APPR.			
				Q.A.			

L LEW ELECTRIC
FITTINGS COMPANY

877-537-2019 www.lewelectric.com

SHEET 1 OF 1

SHEET	DWG. NO.	REV.
A	MOI-SLB-PWR2-COMM4	
SCALE=n.t.s.	WEIGHT:	