


COVER PER SUBMITTAL

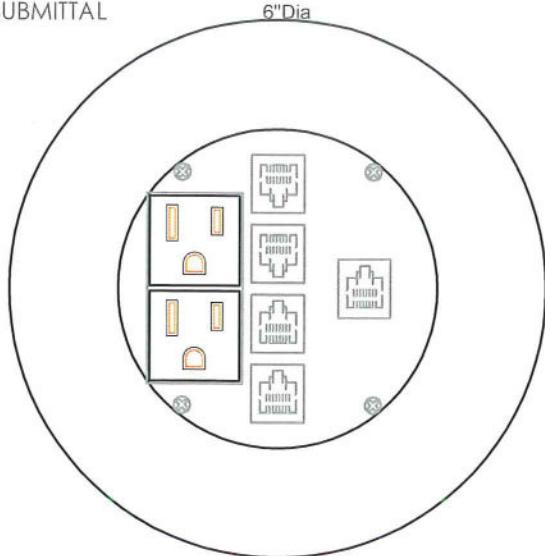

### TOP VIEW


MOI-SLB-PWR2-COMM5

2 single receptacle and 5 openings for COMM jacks (openings suitable for all manufacturers Keystone style jacks)  
COMM jacks not supplied or installed by Nocom Inc.

**NOTE:**


Single receptacle(s) shall be 5-15RA.  
5-20RA available.

## CROSS SECTION

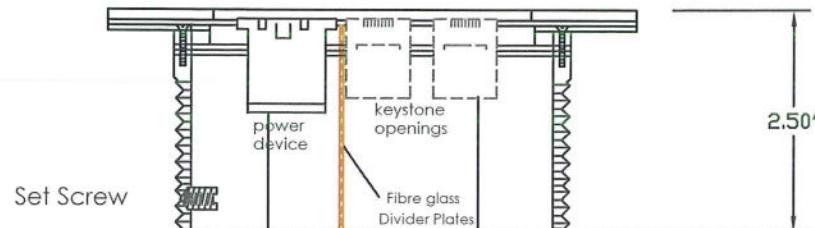


DEVICE MOUNTING BRACKET  
C/W THREAD HUB AS SHOWN

Poured in slab

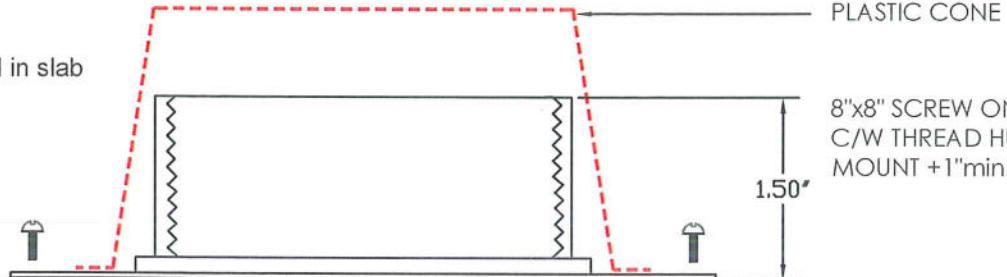

8"x8" SCREW ON COVER (4 CORNERS)  
C/W THREAD HUB AS SHOWN  
MOUNT +1"min. to 2" max.BELOW NEW TILE

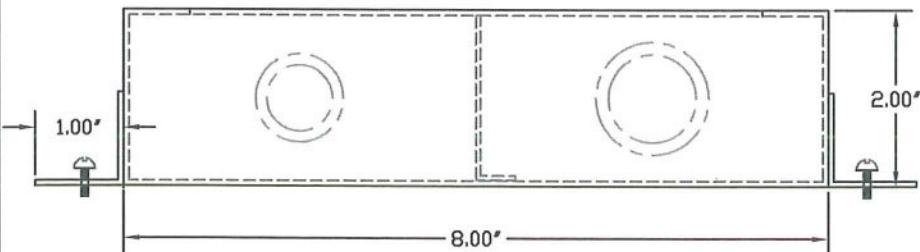

8"x8"x2" STANDARD BOX  
WITH CENTRE BARRIER  
C/W 2x[1/2-3/4"] k.o's  
2x[3/4"-1"] k.o's

NOTE.

**NOTE:**  
Single receptacles shall be CSA / UL Recognized/Classified or Listed Keystone style openings, blanks or CSA/UL Recognized/ Classified or Listed comm jacks

#### ORDERING INFO-(SEE ABBREVIATIONS)

### SLAB THICKNESS

RECEIPT TYPE/colour

DATA MANUF./colour

COVER TYPE



# LEW ELECTRIC FITTINGS COMPANY

877-537-2019 [www.lewelectric.com](http://www.lewelectric.com)

SIZE DWG. NO. MOLDED PLUMS DRAWINGS REV.

SCALE=nts WEIGHT: SHEET 1 OF 1

11. *What is the primary purpose of the following statement?*