


COVER PER SUBMITTAL

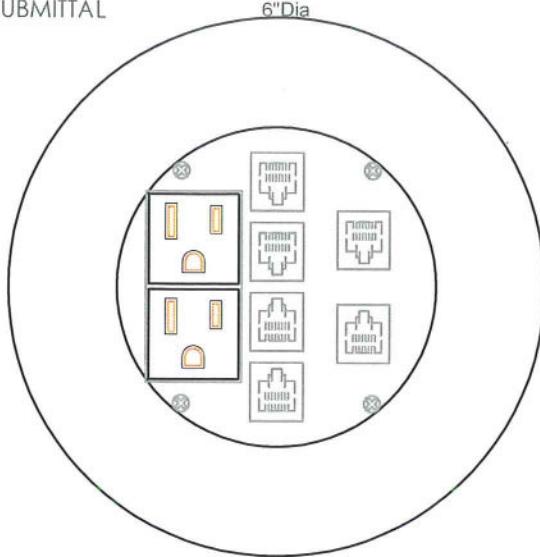

TOP VIEW


MOI-SLB-PWR2-COMM6

2 single receptacle and 6 openings for COMM jacks (openings suitable for all manufacturers Keystone style jacks)
COMM jacks not supplied or installed by Nocom Inc.


NOTE:

Single receptacle(s) shall be 5-15RA.
5-20RA available.


CROSS SECTION

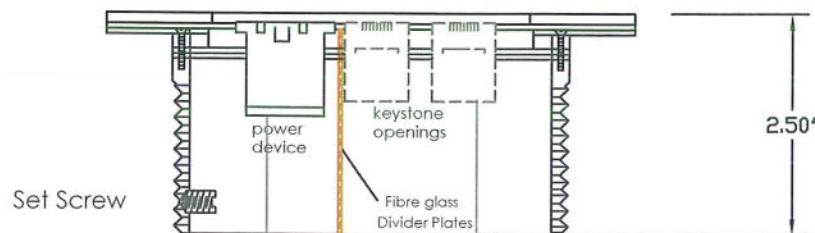

DEVICE MOUNTING BRACKET
C/W THREAD HUB AS SHOWN

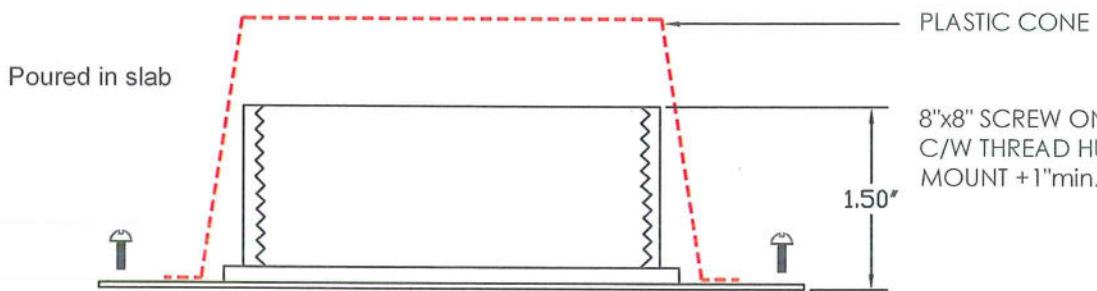

8"x8" SCREW ON COVER (4 CORNERS)
C/W THREAD HUB AS SHOWN
MOUNT +1"min. to 2" max.BELOW NEW TILE

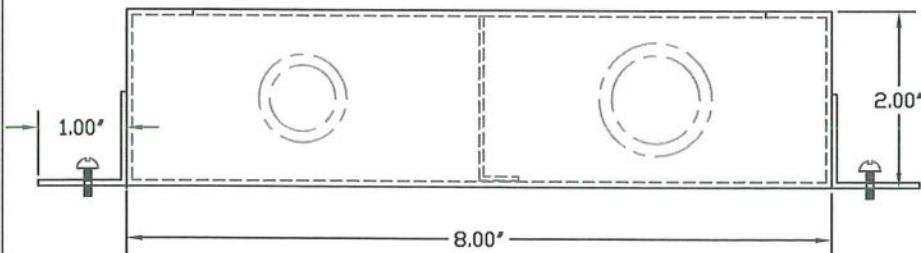

8"x8"x2" STANDARD BOX
WITH CENTRE BARRIER
C/W 2x[1/2-3/4"] k.o's
2x[3/4"-1"] k.o's

ORDERING INFO-(SEE ABBREVIATIONS)

SLAB THICKNESS _____

RECEPT.TYPE/colour _____

DATA MANUF./colour _____

COVER TYPE _____

NOTE:

Single receptacles shall be CSA / UL Recognized/Classified or Listed
Keystone style openings, blanks or CSA/UL Recognized/ Classified or
Listed comm jacks

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS
DRAWING IS THE SOLE PROPERTY OF
NOCOM. ANY REPRODUCTION IN
PART OR AS A WHOLE WITHOUT THE
WRITTEN PERMISSION OF NOCOM
IS PROHIBITED.

		DIMENSIONS ARE IN MM TOLERANCES: ANGLES: \pm DEGREE LINEAR: \pm MM (UNLESS SPECIFIED)		DRAWN	NAME	DATE (yy-mm-dd)	JOB TITLE:
		MATERIAL	See Varient table	CHECKED			
		FINISH		ENG. APPR.			
				MFG APPR.			
				Q.A.			
		COMMENTS:					
NEXT ASST	USED ON	APPLICATION	DO NOT SCALE DRAWING				

L LEW ELECTRIC
FITTINGS COMPANY

877-537-2019 www.lewelectric.com

SIZE	DWG. NO.	REV.
A	MOI-SLB-PWR2-COMM6	
SCALE=n.t.s.	WEIGHT:	SHEET 1 OF 1